



THE ASSEMBLY DRAWINGS YOU HAVE RECEIVED ARE FOR GENERAL REFERENCE. OPTIONAL ACCESSORIES MAY NOT BE SHOWN AS PROVIDED. PLEASE REFER TO YOUR PURCHASE ORDER FOR A COMPLETE DESCRIPTION OF YOUR BOOTH ORDER.

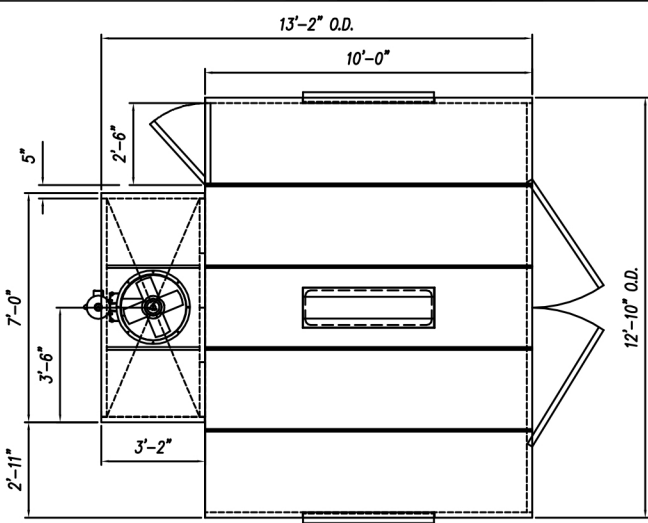


PLAN VIEW

24" DIA TUBEAXIAL FAN UNIT
 RATED FOR 8,000 SCFM EXHAUST @
 1 1/2" SP; DRIVEN BY A 2 HP ODP TYPE
 MOTOR
 2 H.P. 460/60/3 INDUCTION TYPE
 MOTOR. NEC-1999 SECTION 501-8-B

EXHAUST FILTERS, (16) SUPPLIED
 20" X 20" X 2" FILTERS
 WITH GRIDS
 (16) # CLASS 2 OVERSPRAY
 COLLECTION FILTERS MOUNTED
 ON STEEL GRIDS. IFC-2000
 SECTION 1504.3, SECTION 1504.3.1,
 AND SECTION 1504.3.2

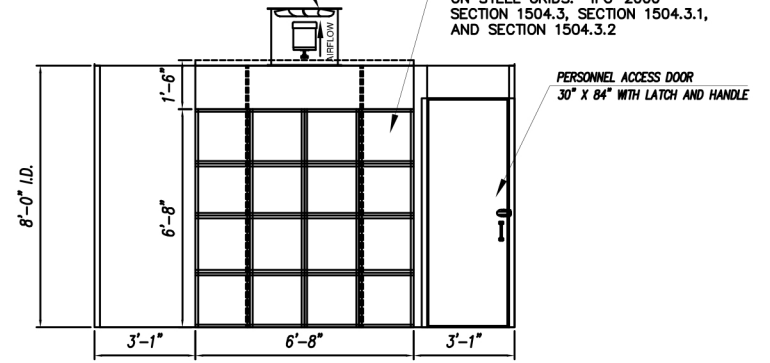


REAR ELEVATION

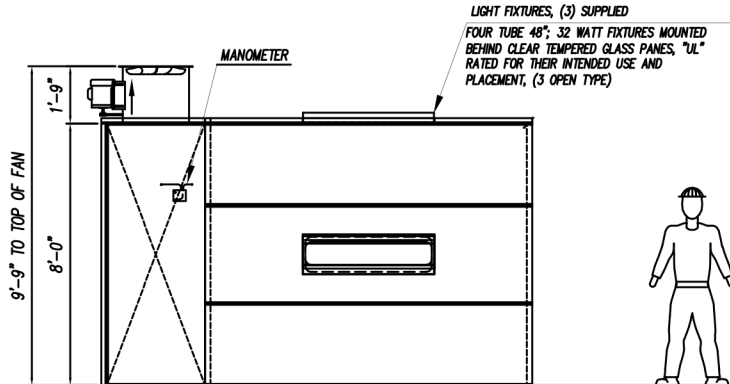

BOOTH SIDE ELEVATION

LIGHT FIXTURES, (3) SUPPLIED
 FOUR TUBE 48"; 32 WATT FIXTURES MOUNTED
 BEHIND CLEAR TEMPERED GLASS PANES, "UL"
 RATED FOR THEIR INTENDED USE AND
 PLACEMENT, (3 OPEN TYPE)

FILTERED PRODUCT ENTRY DOORS
 EQUIPPED WITH (16) 20" x 20" x 1" INTAKE FILTERS,
 1 PANIC LATCH, SWEEP SEAL AND HARDWARE.

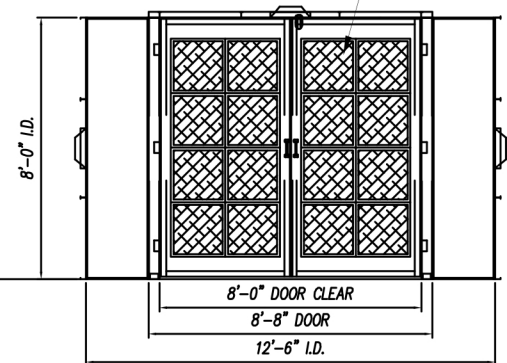

FRONT ELEVATION

BOOTH WALLS & CEILING PANELS
 FABRICATED OF G-90, 18 GA.
 GALVANIZED STEEL IN ACCORDANCE WITH
 THE IFC-2000 SECTION 1504.1.2.1 & NFPA
 -33 CHAPTER 5.1

SEE ORDER
 ACKNOWLEDGEMENT FOR
 COMPLETE LIST OF
 PROVIDED STACK
 COMPONENTS

DESIGNED BY			
DRAWN BY	S.K.		
CHECKED BY	CUSTOMER		
DATE	D.P.		
04-24-06			
SCALE	NTS	TITLE	8710- MOTORCYCLE BOOTH
APPROVED BY	JOB NO. 20427	DWG. NO. 8710	SHEET OF 1 2

T:\Engineering\B.I.N. (BOOTH I.D. NUMBER)\303-8710 MOTORCYCLE\10' cycle booth.dwg, 6/1/2006 3:08:49 PM, somphou